



IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] GEN from UL #13131414.09 and #13131414.01

[TESTLAB]

[ISSUE DATE] 19-DEC-2024

[MANUFAC] WILLIAMS INDOOR

[MORE] H.E. WILLIAMS, INC. - CARTHAGE, MO

[LUMCAT] 4CRDI-xx-L12-835U-L12-835D-xxx-DIM1-UNV-ON-CSU-OW-CSD-WM

[MORE]

[LUMINAIRE] White formed aluminum housing, narrow distrib anodized aluminum reflector trim w/clear cover glass up,

[MORE] wide distrib anodized alum open reflector trim down

[LAMP] Two white LEDs (one up/one down)

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2097
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	74
Total Luminaire Watts	28.5
Ballast Factor	1.00
CIE Type	Semi-Direct
Spacing Criterion (0-180)	1.16
Spacing Criterion (90-270)	1.16
Spacing Criterion (Diagonal)	1.04
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.21 ft (Diameter)
Luminous Width (90-270)	0.21 ft (Diameter)
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	34375	34375	34375
55	9784	9784	9784
65	4439	4439	4439
75	1374	1374	1374
85	370	370	370

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_IES

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>	<u>112.5</u>	<u>135.0</u>	<u>157.5</u>	<u>180.0</u>	<u>202.5</u>
0.0	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621
2.5	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154
5.0	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863
7.5	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770
10.0	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100
12.5	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144
15.0	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457
17.5	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748
20.0	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440
22.5	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626
25.0	949.949	949.949	949.949	949.949	949.949	949.949	949.949	949.949	949.949	949.949
27.5	870.233	870.233	870.233	870.233	870.233	870.233	870.233	870.233	870.233	870.233
30.0	774.676	774.676	774.676	774.676	774.676	774.676	774.676	774.676	774.676	774.676
32.5	669.921	669.921	669.921	669.921	669.921	669.921	669.921	669.921	669.921	669.921
35.0	556.479	556.479	556.479	556.479	556.479	556.479	556.479	556.479	556.479	556.479
37.5	421.268	421.268	421.268	421.268	421.268	421.268	421.268	421.268	421.268	421.268
40.0	266.589	266.589	266.589	266.589	266.589	266.589	266.589	266.589	266.589	266.589
42.5	146.555	146.555	146.555	146.555	146.555	146.555	146.555	146.555	146.555	146.555
45.0	76.803	76.803	76.803	76.803	76.803	76.803	76.803	76.803	76.803	76.803
47.5	47.830	47.830	47.830	47.830	47.830	47.830	47.830	47.830	47.830	47.830
50.0	33.419	33.419	33.419	33.419	33.419	33.419	33.419	33.419	33.419	33.419
52.5	24.375	24.375	24.375	24.375	24.375	24.375	24.375	24.375	24.375	24.375
55.0	17.732	17.732	17.732	17.732	17.732	17.732	17.732	17.732	17.732	17.732
57.5	13.439	13.439	13.439	13.439	13.439	13.439	13.439	13.439	13.439	13.439
60.0	10.475	10.475	10.475	10.475	10.475	10.475	10.475	10.475	10.475	10.475
62.5	8.023	8.023	8.023	8.023	8.023	8.023	8.023	8.023	8.023	8.023
65.0	5.928	5.928	5.928	5.928	5.928	5.928	5.928	5.928	5.928	5.928
67.5	4.139	4.139	4.139	4.139	4.139	4.139	4.139	4.139	4.139	4.139
70.0	2.759	2.759	2.759	2.759	2.759	2.759	2.759	2.759	2.759	2.759
72.5	1.788	1.788	1.788	1.788	1.788	1.788	1.788	1.788	1.788	1.788
75.0	1.124	1.124	1.124	1.124	1.124	1.124	1.124	1.124	1.124	1.124
77.5	0.664	0.664	0.664	0.664	0.664	0.664	0.664	0.664	0.664	0.664
80.0	0.409	0.409	0.409	0.409	0.409	0.409	0.409	0.409	0.409	0.409
82.5	0.204	0.204	0.204	0.204	0.204	0.204	0.204	0.204	0.204	0.204
85.0	0.102	0.102	0.102	0.102	0.102	0.102	0.102	0.102	0.102	0.102
87.5	0.051	0.051	0.051	0.051	0.051	0.051	0.051	0.051	0.051	0.051
90.0	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254
92.5	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672
95.0	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254
97.5	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254	1.254
100.0	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672
102.5	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672
105.0	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672
107.5	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672
110.0	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672	1.672
112.5	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090
115.0	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090
117.5	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090	2.090
120.0	2.508	2.508	2.508	2.508	2.508	2.508	2.508	2.508	2.508	2.508
122.5	2.926	2.926	2.926	2.926	2.926	2.926	2.926	2.926	2.926	2.926
125.0	3.344	3.344	3.344	3.344	3.344	3.344	3.344	3.344	3.344	3.344
127.5	4.180	4.180	4.180	4.180	4.180	4.180	4.180	4.180	4.180	4.180
130.0	5.016	5.016	5.016	5.016	5.016	5.016	5.016	5.016	5.016	5.016
132.5	6.270	6.270	6.270	6.270	6.270	6.270	6.270	6.270	6.270	6.270

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_IES

CANDELA TABULATION - (Cont.)

135.0	7.942	7.942	7.942	7.942	7.942	7.942	7.942	7.942	7.942	7.942
137.5	10.450	10.450	10.450	10.450	10.450	10.450	10.450	10.450	10.450	10.450
140.0	12.958	12.958	12.958	12.958	12.958	12.958	12.958	12.958	12.958	12.958
142.5	16.302	16.302	16.302	16.302	16.302	16.302	16.302	16.302	16.302	16.302
145.0	25.498	25.498	25.498	25.498	25.498	25.498	25.498	25.498	25.498	25.498
147.5	61.028	61.028	61.028	61.028	61.028	61.028	61.028	61.028	61.028	61.028
150.0	139.612	139.612	139.612	139.612	139.612	139.612	139.612	139.612	139.612	139.612
152.5	256.652	256.652	256.652	256.652	256.652	256.652	256.652	256.652	256.652	256.652
155.0	387.068	387.068	387.068	387.068	387.068	387.068	387.068	387.068	387.068	387.068
157.5	509.124	509.124	509.124	509.124	509.124	509.124	509.124	509.124	509.124	509.124
160.0	621.566	621.566	621.566	621.566	621.566	621.566	621.566	621.566	621.566	621.566
162.5	760.342	760.342	760.342	760.342	760.342	760.342	760.342	760.342	760.342	760.342
165.0	977.284	977.284	977.284	977.284	977.284	977.284	977.284	977.284	977.284	977.284
167.5	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886
170.0	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352
172.5	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417
175.0	4129.007	4129.007	4129.007	4129.007	4129.007	4129.006	4129.006	4129.006	4129.006	4129.006
177.5	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441
180.0	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000

Vert. Horizontal Angles

	<u>225.0</u>	<u>247.5</u>	<u>270.0</u>	<u>292.5</u>	<u>315.0</u>	<u>337.5</u>	<u>360.0</u>
0.0	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621	1027.621
2.5	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154	1029.154
5.0	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863	1038.863
7.5	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770	1057.770
10.0	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100	1073.100
12.5	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144	1075.144
15.0	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457	1066.457
17.5	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748	1056.748
20.0	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440	1042.440
22.5	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626	1004.626
25.0	949.949	949.949	949.949	949.949	949.949	949.949	949.949
27.5	870.233	870.233	870.233	870.233	870.233	870.233	870.233
30.0	774.676	774.676	774.676	774.676	774.676	774.676	774.676
32.5	669.921	669.921	669.921	669.921	669.921	669.921	669.921
35.0	556.479	556.479	556.479	556.479	556.479	556.479	556.479
37.5	421.268	421.268	421.268	421.268	421.268	421.268	421.268
40.0	266.589	266.589	266.589	266.589	266.589	266.589	266.589
42.5	146.555	146.555	146.555	146.555	146.555	146.555	146.555
45.0	76.803	76.803	76.803	76.803	76.803	76.803	76.803
47.5	47.830	47.830	47.830	47.830	47.830	47.830	47.830
50.0	33.419	33.419	33.419	33.419	33.419	33.419	33.419
52.5	24.375	24.375	24.375	24.375	24.375	24.375	24.375
55.0	17.732	17.732	17.732	17.732	17.732	17.732	17.732
57.5	13.439	13.439	13.439	13.439	13.439	13.439	13.439
60.0	10.475	10.475	10.475	10.475	10.475	10.475	10.475
62.5	8.023	8.023	8.023	8.023	8.023	8.023	8.023
65.0	5.928	5.928	5.928	5.928	5.928	5.928	5.928
67.5	4.139	4.139	4.139	4.139	4.139	4.139	4.139
70.0	2.759	2.759	2.759	2.759	2.759	2.759	2.759
72.5	1.788	1.788	1.788	1.788	1.788	1.788	1.788
75.0	1.124	1.124	1.124	1.124	1.124	1.124	1.124
77.5	0.664	0.664	0.664	0.664	0.664	0.664	0.664
80.0	0.409	0.409	0.409	0.409	0.409	0.409	0.409

IES INDOOR REPORT**PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_IES****CANDELA TABULATION - (Cont.)**

82.5	0.204	0.204	0.204	0.204	0.204	0.204	0.204
85.0	0.102	0.102	0.102	0.102	0.102	0.102	0.102
87.5	0.051	0.051	0.051	0.051	0.051	0.051	0.051
90.0	1.254	1.254	1.254	1.254	1.254	1.254	1.254
92.5	1.672	1.672	1.672	1.672	1.672	1.672	1.672
95.0	1.254	1.254	1.254	1.254	1.254	1.254	1.254
97.5	1.254	1.254	1.254	1.254	1.254	1.254	1.254
100.0	1.672	1.672	1.672	1.672	1.672	1.672	1.672
102.5	1.672	1.672	1.672	1.672	1.672	1.672	1.672
105.0	1.672	1.672	1.672	1.672	1.672	1.672	1.672
107.5	1.672	1.672	1.672	1.672	1.672	1.672	1.672
110.0	1.672	1.672	1.672	1.672	1.672	1.672	1.672
112.5	2.090	2.090	2.090	2.090	2.090	2.090	2.090
115.0	2.090	2.090	2.090	2.090	2.090	2.090	2.090
117.5	2.090	2.090	2.090	2.090	2.090	2.090	2.090
120.0	2.508	2.508	2.508	2.508	2.508	2.508	2.508
122.5	2.926	2.926	2.926	2.926	2.926	2.926	2.926
125.0	3.344	3.344	3.344	3.344	3.344	3.344	3.344
127.5	4.180	4.180	4.180	4.180	4.180	4.180	4.180
130.0	5.016	5.016	5.016	5.016	5.016	5.016	5.016
132.5	6.270	6.270	6.270	6.270	6.270	6.270	6.270
135.0	7.942	7.942	7.942	7.942	7.942	7.942	7.942
137.5	10.450	10.450	10.450	10.450	10.450	10.450	10.450
140.0	12.958	12.958	12.958	12.958	12.958	12.958	12.958
142.5	16.302	16.302	16.302	16.302	16.302	16.302	16.302
145.0	25.498	25.498	25.498	25.498	25.498	25.498	25.498
147.5	61.028	61.028	61.028	61.028	61.028	61.028	61.028
150.0	139.612	139.612	139.612	139.612	139.612	139.612	139.612
152.5	256.652	256.652	256.652	256.652	256.652	256.652	256.652
155.0	387.068	387.068	387.068	387.068	387.068	387.068	387.068
157.5	509.124	509.124	509.124	509.124	509.124	509.124	509.124
160.0	621.566	621.566	621.566	621.566	621.566	621.566	621.566
162.5	760.342	760.342	760.342	760.342	760.342	760.342	760.342
165.0	977.284	977.284	977.284	977.284	977.284	977.284	977.284
167.5	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886	1348.886
170.0	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352	1991.352
172.5	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417	2977.417
175.0	4129.006	4129.006	4129.007	4129.007	4129.007	4129.007	4129.007
177.5	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441	5049.441
180.0	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000	5404.000

IES INDOOR REPORT**PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	401.55	N.A.	19.20
0-30	829.93	N.A.	39.60
0-40	1164.3	N.A.	55.50
0-60	1260.71	N.A.	60.10
0-80	1268.15	N.A.	60.50
0-90	1268.47	N.A.	60.50
10-90	1168.06	N.A.	55.70
20-40	762.75	N.A.	36.40
20-50	841.98	N.A.	40.20
40-70	102.49	N.A.	4.90
60-80	7.44	N.A.	0.40
70-80	1.36	N.A.	0.10
80-90	0.32	N.A.	0.00
90-110	3.31	N.A.	0.20
90-120	5.38	N.A.	0.30
90-130	8.55	N.A.	0.40
90-150	41.73	N.A.	2.00
90-180	828.34	N.A.	39.50
110-180	825.03	N.A.	39.30
0-180	2096.81	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	100.41
10-20	301.14
20-30	428.38
30-40	334.37
40-50	79.22
50-60	17.19
60-70	6.08
70-80	1.36
80-90	0.32
90-100	1.54
100-110	1.77
110-120	2.07
120-130	3.17
130-140	6.43
140-150	26.75
150-160	170.79
160-170	292.64
170-180	323.18

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	66	66	66	60
1	103	99	96	94	96	93	91	89	82	80	79	72	71	69	62	61	61	56
2	96	90	86	82	90	85	81	78	76	73	70	67	65	63	58	57	56	52
3	90	82	77	72	84	78	73	69	70	66	63	62	59	57	55	53	51	48
4	84	75	69	64	79	72	66	62	64	60	57	58	55	52	51	49	47	44
5	79	69	63	58	74	66	60	56	60	55	52	54	50	48	48	46	44	41
6	74	64	57	52	70	61	55	50	55	51	47	50	46	44	45	43	40	38
7	69	59	52	48	65	56	50	46	51	47	43	47	43	40	42	40	37	35
8	65	55	48	43	62	52	46	42	48	43	40	44	40	37	40	37	35	33
9	61	51	44	40	58	49	43	39	45	40	37	41	37	35	38	35	32	31
10	58	47	41	37	55	45	40	36	42	37	34	39	35	32	35	32	30	29

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	6.3	7.0	7.3	7.9	9.1	6.3	7.0	7.3	7.9	9.1
	3H	6.6	7.2	7.5	8.1	9.3	6.6	7.2	7.5	8.1	9.3
	4H	6.5	7.1	7.5	8.0	9.2	6.5	7.1	7.5	8.0	9.2
	6H	6.5	7.0	7.4	7.9	9.1	6.5	7.0	7.4	7.9	9.1
	8H	6.4	6.9	7.3	7.8	9.0	6.4	6.9	7.3	7.8	9.0
	12H	6.3	6.8	7.3	7.7	8.9	6.3	6.8	7.3	7.7	8.9

UGR Viewed Endwise


4H	2H	6.4	6.9	7.3	7.8	9.0	6.4	6.9	7.3	7.8	9.0
	3H	6.7	7.1	7.6	8.1	9.3	6.7	7.1	7.6	8.1	9.3
	4H	6.6	7.1	7.6	8.0	9.2	6.6	7.1	7.6	8.0	9.2
	6H	6.6	6.9	7.5	7.9	9.1	6.6	6.9	7.5	7.9	9.1
	8H	6.5	6.8	7.5	7.8	9.0	6.5	6.8	7.5	7.8	9.0
	12H	6.4	6.7	7.4	7.7	8.9	6.4	6.7	7.4	7.7	8.9
8H	4H	6.5	6.8	7.5	7.8	9.0	6.5	6.8	7.5	7.8	9.0
	6H	6.4	6.7	7.4	7.7	8.9	6.4	6.7	7.4	7.7	8.9
	8H	6.4	6.6	7.4	7.6	8.8	6.4	6.6	7.4	7.6	8.8
	12H	6.3	6.5	7.3	7.5	8.8	6.3	6.5	7.3	7.5	8.8
12H	4H	6.4	6.7	7.4	7.7	8.9	6.4	6.7	7.4	7.7	8.9
	6H	6.4	6.6	7.4	7.6	8.8	6.4	6.6	7.4	7.6	8.8
	8H	6.3	6.5	7.3	7.5	8.8	6.3	6.5	7.3	7.5	8.8

Maximum UGR = 9.3

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 4CRDI-XX-L12-835U-L12-835D-XXX-DIM1-UNV-ON-CSU-OW-CSD-WM_.IES

POLAR GRAPH

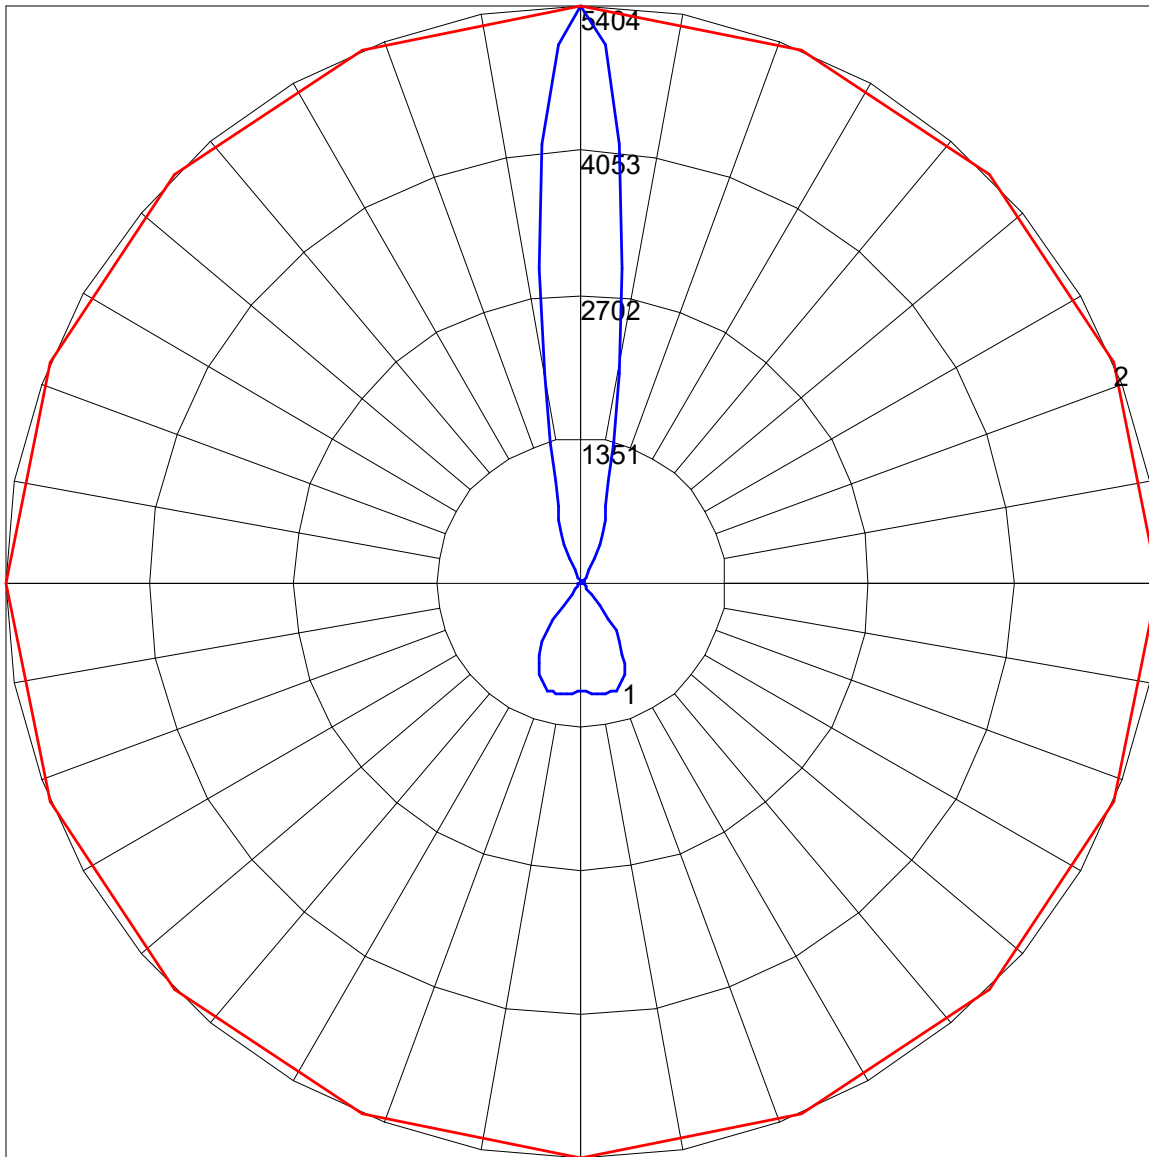

Maximum Candela = 5404 Located At Horizontal Angle = 0, Vertical Angle = 180

1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)

2 - Horizontal Cone Through Vertical Angle (180) (Through Max. Cd.)