



IES INDOOR REPORT

PHOTOMETRIC FILENAME : AT1-24-L100-835-D-DIM-UNV_.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] GEN from BALLABS TEST NO. 18876.0

[TESTLAB] BUILDING ACOUSTICS & LIGHTING LABORATORIES, INC

[ISSUEDATE] 05-18-2020

[MANUFAC] WILLIAMS INDOOR

[OTHER] H.E. WILLIAMS, INC - CARTHAGE, MO 64836

[LUMINAIRE] 2x4 'RECESSED LUMINAIRE

[MORE] WITH FROST CONCAVE ACRYLIC LENS w/SHALLOW ACRYLIC CENTER

[MORE] DIFFUSER

[LUMCAT] AT1-24-L100-835-D-DIM-UNV

[LAMPCAT] HLM 80 CRI, 3500K CCT

[_SEARCH_SOURCETYPE] LED

[_SEARCH_APPLICATION] Indoor, Architectural, Classroom, Commercial, Educational, Office, Direct

[_SEARCH_MOUNTING] Ceiling, Recessed

[_SEARCH_CERTIFICATION] DLC

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	10124
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	114
Total Luminaire Watts	89
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.12
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.32
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.76 ft
Luminous Width (90-270)	1.77 ft
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	4623	5406	5865
55	4010	4910	5291
65	3565	4674	5052
75	3044	4525	4649
85	2566	2749	2810

IES INDOOR REPORT
PHOTOMETRIC FILENAME : AT1-24-L100-835-D-DIM-UNV_.IES

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>
0	3895.496	3895.496	3895.496	3895.496	3895.496
5	3898.783	3895.496	3905.358	3905.358	3908.645
10	3793.588	3796.875	3819.887	3839.611	3849.473
15	3662.095	3681.819	3724.554	3770.577	3796.875
20	3431.981	3481.291	3553.612	3642.371	3681.819
25	3159.132	3205.155	3323.499	3451.705	3507.590
30	2889.570	2952.030	3116.396	3280.763	3343.223
35	2652.882	2728.491	2925.731	3106.534	3172.281
40	2304.424	2393.182	2613.434	2790.950	2840.260
45	2018.426	2113.758	2360.309	2511.526	2560.836
50	1709.416	1817.898	2041.437	2172.930	2209.091
55	1420.130	1531.900	1739.002	1844.197	1873.783
60	1167.005	1278.774	1466.153	1554.911	1581.210
65	930.317	1051.948	1219.602	1295.211	1318.223
70	703.490	831.697	976.339	1032.224	1042.086
75	486.526	618.020	723.214	749.513	742.938
80	305.722	424.067	463.515	355.033	322.159
85	138.068	193.953	147.930	147.930	151.218
90	0.000	0.000	0.000	0.000	0.000

IES INDOOR REPORT
PHOTOMETRIC FILENAME : AT1-24-L100-835-D-DIM-UNV_.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	1417.49	N.A.	14.00
0-30	2955.4	N.A.	29.20
0-40	4763.5	N.A.	47.00
0-60	8065.73	N.A.	79.70
0-80	9932.18	N.A.	98.10
0-90	10124.45	N.A.	100.00
10-90	9754.99	N.A.	96.40
20-40	3346.01	N.A.	33.00
20-50	5127.62	N.A.	50.60
40-70	4464.16	N.A.	44.10
60-80	1866.45	N.A.	18.40
70-80	704.53	N.A.	7.00
80-90	192.27	N.A.	1.90
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	10124.45	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	369.46
10-20	1048.03
20-30	1537.91
30-40	1808.09
40-50	1781.61
50-60	1520.62
60-70	1161.93
70-80	704.53
80-90	192.27
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : AT1-24-L100-835-D-DIM-UNV_.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	98	94	92	94	91	89	90	88	86	84
2	99	91	84	79	97	89	83	78	86	80	76	82	78	74	79	76	72	70
3	91	80	72	66	88	79	71	65	76	69	64	73	67	63	70	66	62	59
4	83	71	62	56	81	70	62	55	67	60	55	65	59	54	63	58	53	51
5	76	64	55	48	74	63	54	48	61	53	47	59	52	47	57	51	46	44
6	71	58	49	42	69	57	48	42	55	47	42	53	46	41	52	46	41	39
7	66	52	44	38	64	51	43	37	50	43	37	48	42	37	47	41	37	35
8	61	48	39	34	60	47	39	33	46	38	33	45	38	33	43	37	33	31
9	57	44	36	30	56	43	36	30	42	35	30	41	35	30	40	34	30	28
10	54	41	33	28	52	40	33	27	39	32	27	38	32	27	37	31	27	25

IES INDOOR REPORT
PHOTOMETRIC FILENAME : AT1-24-L100-835-D-DIM-UNV_.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	16.5	18.1	16.8	18.4	18.7	17.9	19.5	18.3	19.8	20.2
	3H	18.2	19.6	18.6	20.0	20.3	19.9	21.3	20.3	21.7	22.0
	4H	18.8	20.2	19.2	20.5	20.9	20.6	22.0	21.0	22.4	22.7
	6H	19.3	20.6	19.7	21.0	21.4	21.0	22.3	21.5	22.7	23.1
	8H	19.5	20.7	19.9	21.1	21.5	21.1	22.3	21.6	22.7	23.1
	12H	19.6	20.8	20.0	21.2	21.6	21.2	22.4	21.6	22.7	23.2
4H	2H	17.4	18.8	17.8	19.1	19.5	18.5	19.9	18.9	20.2	20.6
	3H	19.4	20.5	19.8	20.9	21.3	20.7	21.9	21.1	22.3	22.7
	4H	20.2	21.2	20.6	21.6	22.0	21.6	22.7	22.1	23.1	23.5
	6H	20.8	21.7	21.3	22.2	22.6	22.1	23.0	22.6	23.5	23.9
	8H	21.0	21.9	21.5	22.3	22.8	22.3	23.1	22.7	23.5	24.0
	12H	21.2	22.0	21.7	22.4	22.9	22.3	23.1	22.8	23.6	24.1
8H	4H	20.7	21.5	21.1	22.0	22.4	21.9	22.8	22.4	23.2	23.7
	6H	21.5	22.2	22.0	22.7	23.2	22.6	23.3	23.0	23.7	24.2
	8H	21.8	22.5	22.3	23.0	23.5	22.7	23.4	23.2	23.9	24.4
	12H	22.1	22.7	22.6	23.1	23.7	22.9	23.5	23.4	23.9	24.5
12H	4H	20.7	21.5	21.2	22.0	22.4	22.0	22.7	22.4	23.2	23.7
	6H	21.6	22.3	22.1	22.7	23.3	22.6	23.3	23.1	23.7	24.3
	8H	22.0	22.6	22.5	23.1	23.6	22.9	23.4	23.4	23.9	24.5

Maximum UGR = 24.5

POLAR GRAPH

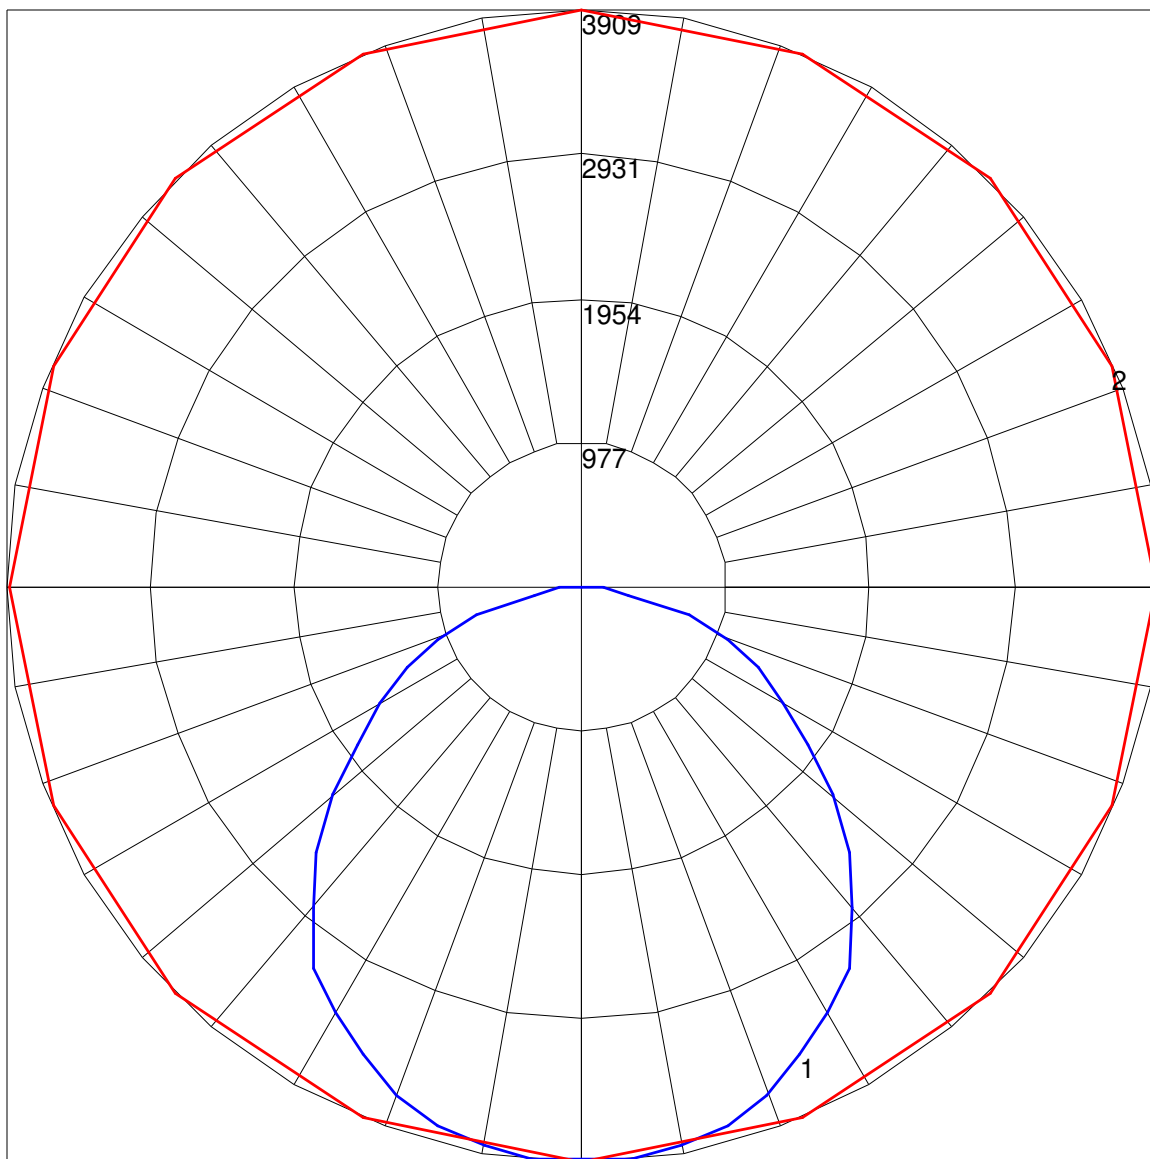

Maximum Candela = 3908.645 Located At Horizontal Angle = 90, Vertical Angle = 5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (5) (Through Max. Cd.)