



IES INDOOR REPORT

PHOTOMETRIC FILENAME : PTDC-24-L61-940-RA-DIM-UNV_.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
 [TEST] GEN FROM BALLABS TEST NO. 19235.0
 [TESTLAB] BUILDING ACOUSTICS & LIGHTING LABORATORIES, INC
 [ISSUEDATE] 2022-05-06
 [MANUFAC] WILLIAMS INDOOR
 [OTHER] H.E. WILLIAMS, INC - CARTHAGE, MO
 [LUMINAIRE] 2x4' RECESSED LED LUMINAIRE
 [MORE] w/RIBBED FROSTED ACRYLIC CENTER DIFFUSER
 [LUMCAT] PTDC-24-L61-940-RA-DIM-UNV
 [LAMPCAT] HLM 90 CRI 4000K CCT
 [_SEARCH_SOURCETYPE] LED
 [_SEARCH_APPLICATION] Indoor, Architectural, Office, Direct
 [_SEARCH_MOUNTING] Recessed

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5211
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	107
Total Luminaire Watts	48.5
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.14
Spacing Criterion (90-270)	1.18
Spacing Criterion (Diagonal)	1.28
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.92 ft
Luminous Width (90-270)	1.92 ft
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	2235	2358	2478
55	2003	2192	2368
65	1761	2086	2370
75	1362	2092	2590
85	823	2746	3146

IES INDOOR REPORT
 PHOTOMETRIC FILENAME : PTDC-24-L61-940-RA-DIM-UNV_.IES

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>
0	1993.516	1993.516	1993.516	1993.516	1993.516
5	1963.075	1960.369	1960.369	1953.605	1950.222
10	1956.987	1956.987	1960.369	1963.075	1963.075
15	1905.576	1908.282	1911.664	1916.400	1919.782
20	1779.756	1786.520	1794.638	1805.461	1808.843
25	1678.964	1685.052	1701.287	1715.492	1722.257
30	1471.292	1425.969	1611.318	1557.878	1549.761
35	1356.971	1369.823	1400.264	1425.969	1436.116
40	1207.474	1223.709	1257.532	1291.354	1304.207
45	1103.300	1117.505	1164.181	1207.474	1223.709
50	958.538	980.861	1032.272	1077.594	1093.153
55	802.277	826.629	878.040	929.450	948.391
60	654.133	679.838	738.013	790.777	810.394
65	519.518	553.341	615.575	677.132	699.455
70	382.874	422.785	496.519	561.458	583.781
75	246.230	295.611	378.139	443.755	468.107
80	135.291	199.554	294.258	358.522	378.139
85	50.058	114.321	167.085	188.055	191.437
90	0.000	0.000	0.000	0.000	0.000

IES INDOOR REPORT
PHOTOMETRIC FILENAME : PTDC-24-L61-940-RA-DIM-UNV_.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	722.65	N.A.	13.90
0-30	1497.68	N.A.	28.70
0-40	2371.35	N.A.	45.50
0-60	4049.76	N.A.	77.70
0-80	5055.04	N.A.	97.00
0-90	5210.87	N.A.	100.00
10-90	5023.48	N.A.	96.40
20-40	1648.71	N.A.	31.60
20-50	2539.83	N.A.	48.70
40-70	2286.14	N.A.	43.90
60-80	1005.28	N.A.	19.30
70-80	397.54	N.A.	7.60
80-90	155.83	N.A.	3.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	5210.87	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	187.39
10-20	535.26
20-30	775.03
30-40	873.67
40-50	891.12
50-60	787.28
60-70	607.74
70-80	397.54
80-90	155.83
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : PTDC-24-L61-940-RA-DIM-UNV_.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	93	90	93	90	88	89	87	85	83
2	98	90	83	77	96	88	82	76	85	79	74	81	77	73	78	74	71	69
3	90	79	71	64	87	78	70	64	75	68	63	72	66	61	69	64	60	58
4	82	70	61	55	80	69	61	54	66	59	53	64	58	53	62	56	52	50
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	46	40	51	45	40	38
7	65	52	43	37	63	51	42	37	49	42	36	48	41	36	46	40	36	34
8	61	47	39	33	59	46	38	33	45	38	32	44	37	32	43	37	32	30
9	57	43	35	30	55	43	35	30	42	34	29	41	34	29	40	33	29	27
10	53	40	32	27	52	40	32	27	39	32	27	38	31	27	37	31	27	25

IES INDOOR REPORT
PHOTOMETRIC FILENAME : PTDC-24-L61-940-RA-DIM-UNV_.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	14.1	15.7	14.4	16.0	16.3	15.1	16.7	15.4	17.0	17.3
	3H	15.7	17.2	16.1	17.5	17.9	17.2	18.7	17.6	19.1	19.4
	4H	16.3	17.7	16.7	18.0	18.4	18.2	19.6	18.6	20.0	20.4
	6H	16.6	18.0	17.1	18.3	18.7	19.3	20.6	19.7	20.9	21.3
	8H	16.8	18.0	17.2	18.4	18.8	19.7	20.9	20.1	21.3	21.7
	12H	16.8	18.0	17.3	18.4	18.8	20.0	21.2	20.5	21.6	22.0

UGR Viewed Endwise


4H	2H	14.8	16.2	15.2	16.6	17.0	15.6	17.0	16.0	17.4	17.7
	3H	16.7	17.9	17.2	18.3	18.7	18.1	19.3	18.5	19.7	20.1
	4H	17.4	18.5	17.9	18.9	19.4	19.2	20.3	19.7	20.7	21.2
	6H	18.0	18.9	18.4	19.4	19.8	20.5	21.4	20.9	21.9	22.3
	8H	18.1	19.0	18.6	19.5	19.9	21.0	21.9	21.5	22.3	22.8
	12H	18.3	19.1	18.8	19.5	20.0	21.4	22.2	21.9	22.7	23.2

8H	4H	18.0	18.9	18.5	19.4	19.8	19.6	20.5	20.0	20.9	21.4
	6H	18.8	19.5	19.3	20.0	20.5	21.0	21.8	21.5	22.3	22.7
	8H	19.1	19.7	19.6	20.2	20.7	21.7	22.4	22.2	22.9	23.3
	12H	19.3	19.9	19.8	20.4	20.9	22.3	22.8	22.8	23.3	23.9

12H	4H	18.2	19.0	18.7	19.5	19.9	19.6	20.4	20.1	20.9	21.4
	6H	19.0	19.7	19.6	20.2	20.7	21.1	21.8	21.7	22.3	22.8
	8H	19.4	20.0	19.9	20.5	21.1	21.9	22.4	22.4	22.9	23.5

Maximum UGR = 23.9

POLAR GRAPH

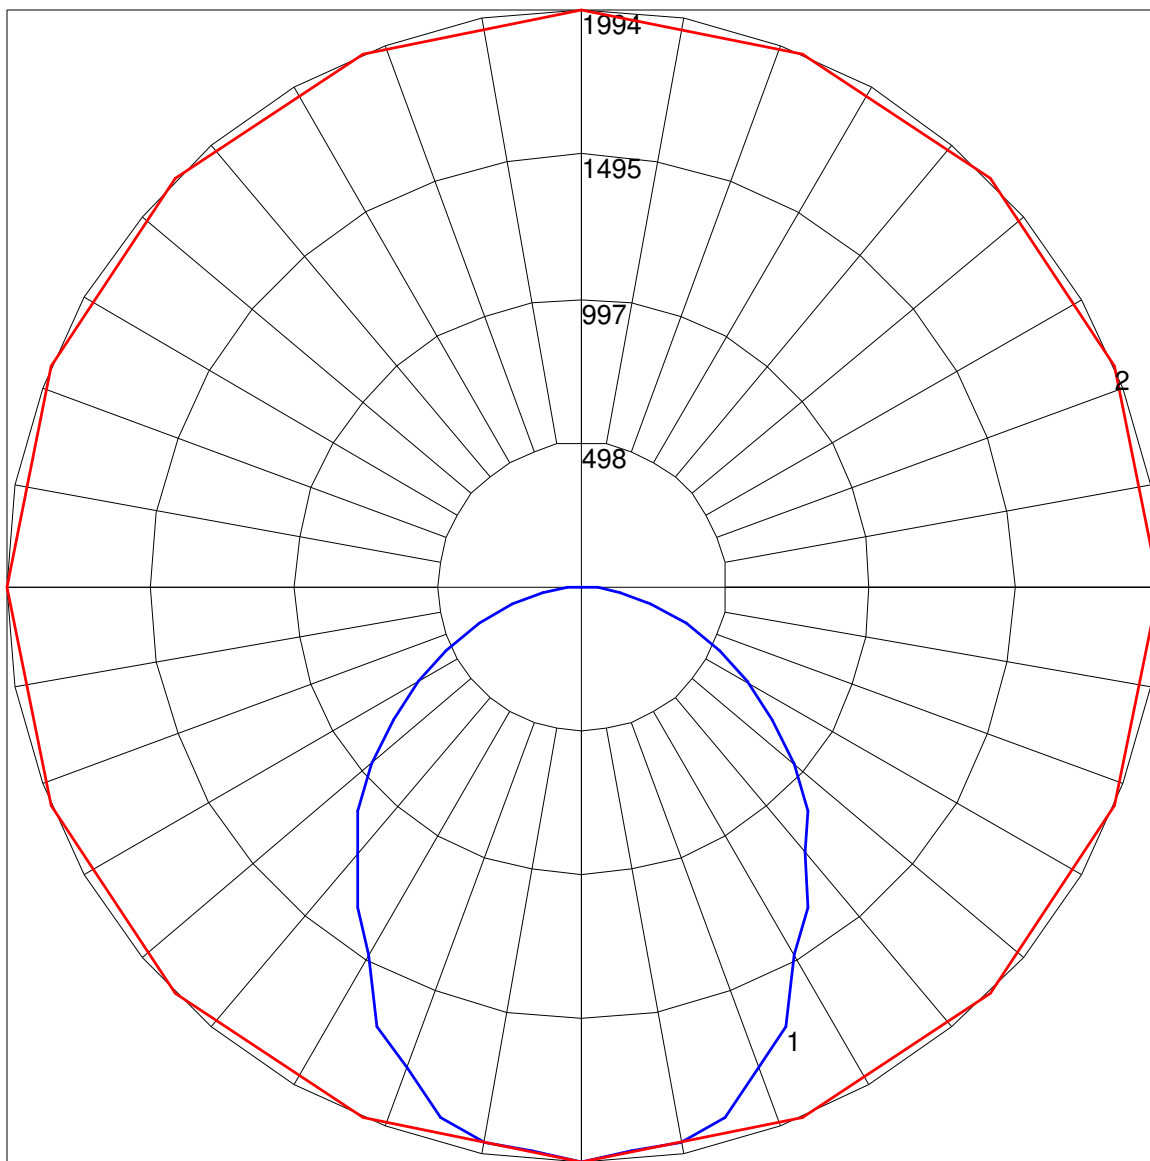

Maximum Candela = 1993.516 Located At Horizontal Angle = 0, Vertical Angle = 0
1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)